
Complete Specification Sheet

Vine™ Static White

LINEAR LED

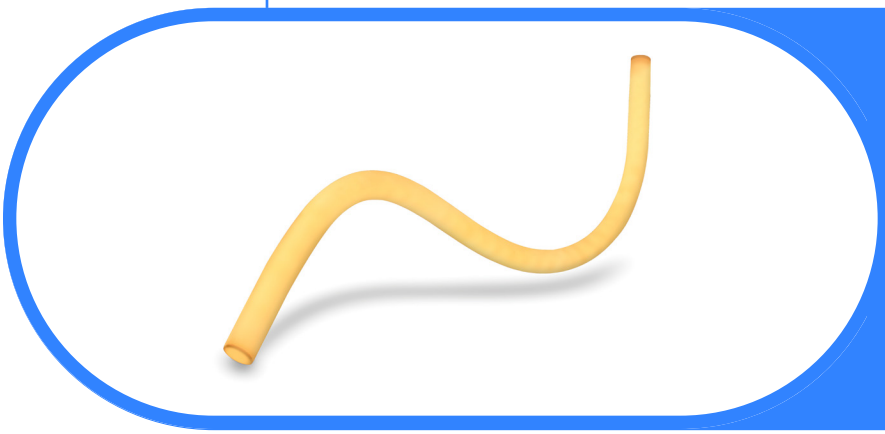

Vine™ Static White

Flexible Lighting System

RoHS COMPLIANT | c UL us LISTED | 24V DC | Dry Rated


Specifications

Category	Linear LED
Series	Vine
Family	Static White
Watts Per Foot	4.39 W/ft
Environment	IP67
CRI	90+
CCT Options	2400K, 2700K, 3000K, 3500K, 4000K, 5000K
Input Voltage	24V DC
Width	1.0in (25mm)
Height	1.0in (25mm)
Max Run Length	16.4ft (5m)
Cut Intervals	0.47in (11.9mm)
Bend Diameter	4.72in (120mm)
Beam Angle	360°
Operating Temp.	-22°F (-30°C) to 131°F (55°C)
Dimming Options	PWM, Triac, 0–10V, DMX, Hi-lume

Features

- 360º Continuous Light Source
- Universal Dimming
- 36,000 Hour Life
- IP65 Rated for Outdoor Use
- Factory-Installed Power Feed
- Injection-Molded Flush End Caps
- For Use with 24V Power Supplies

Dimensions

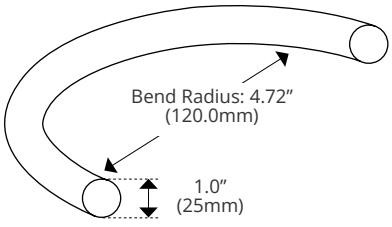

Kelvix reserves the right to update the product specifications at any time. To maintain warranty, field modifications must follow approved Kelvix installation instruction.
Conforms to ANSI/UL Standard 2108
Certified to CAN/CSA Standard C22.2 No. 250.2

Fixture Type _____

Project Name _____

Location _____


Product Code Builder

Vine™ Static White

LINEAR LED

Product Code Builder

Example: VN-25-XX-24K-SF-72

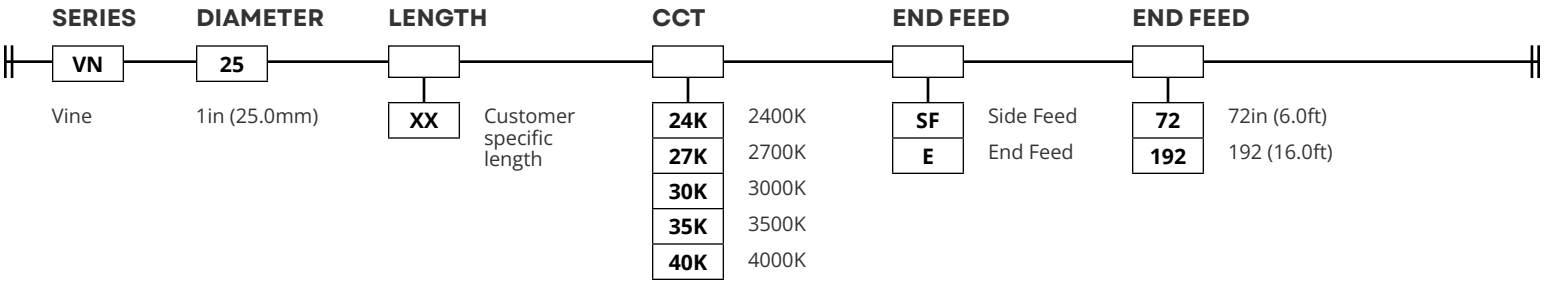

PRODUCT DATA

Color	2400K	2700K	3000K	3500K	4000K
Lumens (lm/ft)	230	268	275	281	290

Kelvix reserves the right to update the product specifications at any time. To maintain warranty, field modifications must follow approved Kelvix installation instruction.
Conforms to ANSI/UL Standard 2108
Certified to CAN/CSA Standard C22.2 No. 250.2

Fixture Type _____

Project Name _____

Location _____

Mounting Options

Vine™ Static White

Mounting Options


IMAGE | **SPECIFICATIONS** | **DIMENSIONS**


Polycarbonate Mounting Clip



VN-25-CP

Length	0.98in (25.0mm)
Width	2.03in (51.6mm)
Height	1.06in (27.0mm)
Internal Height	1.00in (25.4mm)

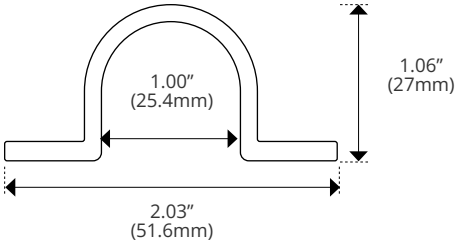

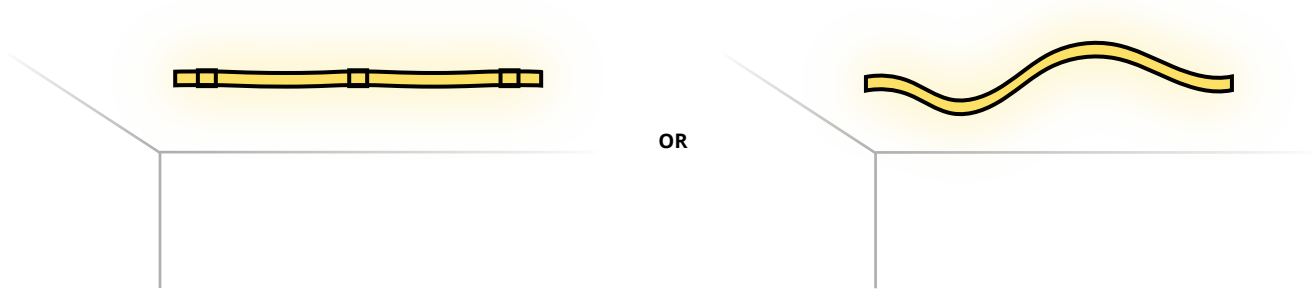


OR


Concealed Mounting Clip



VN-25-CCP

Length	1.43in (36mm)
Width	0.75in (19mm)
Height	0.27in (7mm)
Effective Height	0.11in (3mm)

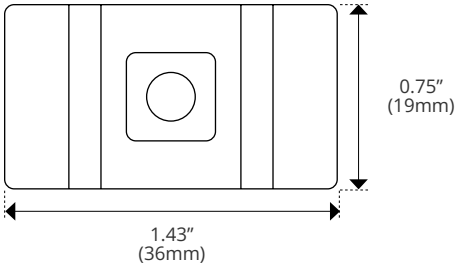

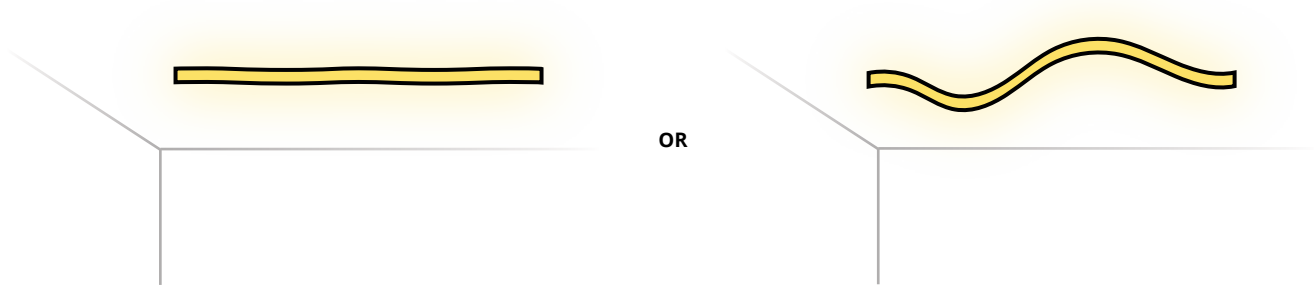

OR

Kelvix reserves the right to update the product specifications at any time. To maintain warranty, field modifications must follow approved Kelvix installation instruction.
Conforms to ANSI/UL Standard 2108
Certified to CAN/CSA Standard C22.2 No. 250.2

Fixture Type _____

Project Name _____

Location _____

Mounting Options

Vine™ Static White

Mounting Options

Splice


IMAGE




SPECIFICATIONS

VN-25-CS	
Length	1.35in (34.5mm)
Diameter	1.22in (31.0mm)
Internal Diameter	1.00 (25.4mm)

DIMENSIONS

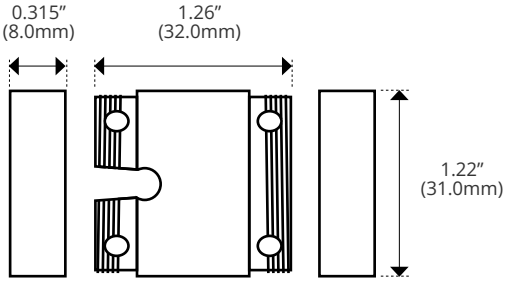

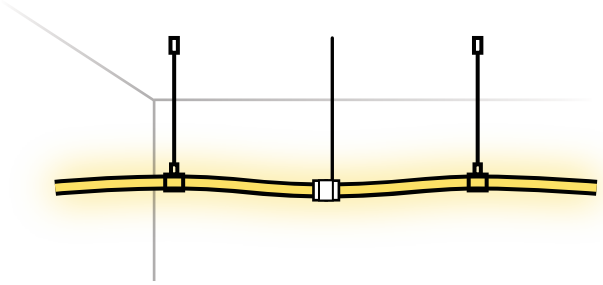

Arch


IMAGE




SPECIFICATIONS

VN-25-MA-FF	
Length	1.65in (42.0mm)
Diameter	1.28in (32.5mm)
Internal Diameter	1.00 (25.4mm)

DIMENSIONS

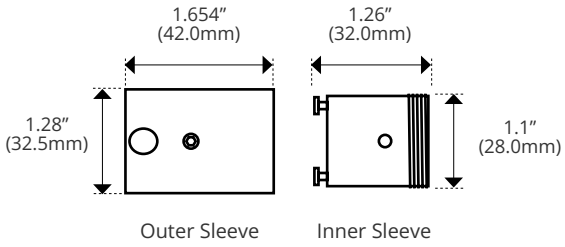

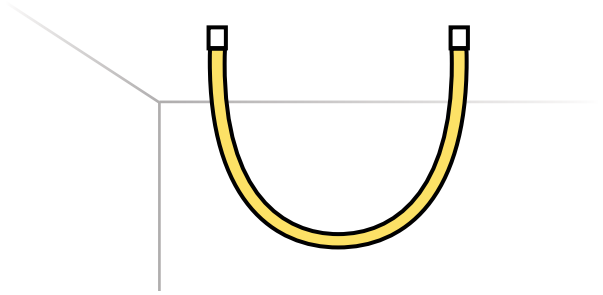

Kelvix reserves the right to update the product specifications at any time. To maintain warranty, field modifications must follow approved Kelvix installation instruction.
Conforms to ANSI/UL Standard 2108
Certified to CAN/CSA Standard C22.2 No. 250.2

Fixture Type _____

Project Name _____

Location _____

Mounting Options

Vine™ Static White

Mounting Options

IMAGE

Flush Pendant



SPECIFICATIONS

VN-25-FP-FF


EC Length	1.32in (33.5mm)
EC Diameter	1.24in (31.5mm)
CM Length	1.65in (42.0mm)
CM Diameter	1.28" (32.5mm)
Internal Diameter	1.00in (25.4mm)

VN-25-FP-2M*


*Polycarbonate sleeve (not pictured) is required for Vine to hang perfectly vertical. See suspended pendant installation instructions for more info.


DIMENSIONS

EC - End Cap

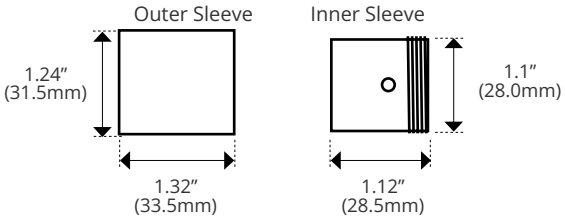

CM - Ceiling Mount

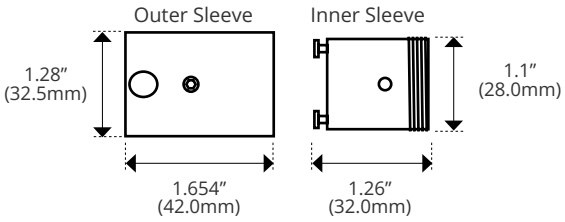

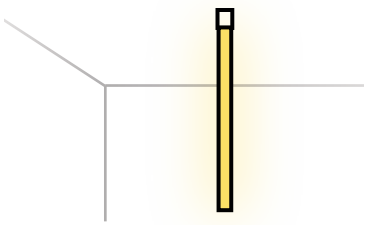


Suspended Pendant




VN-25-SP-V-FF

EC Length	1.65in (42mm)
EC Diameter	1.24in (31.5mm)
SP Length	2.68in (68mm)
SP Diameter	1.24in (31.5mm)
Internal Diameter	1.00in (25.4mm)


Not compatible with SF - Side Feed Configured Product

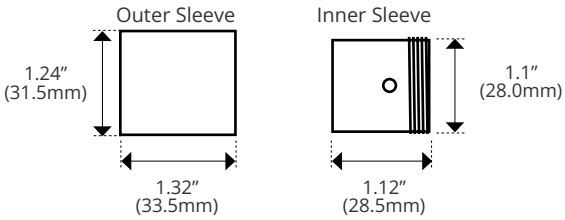

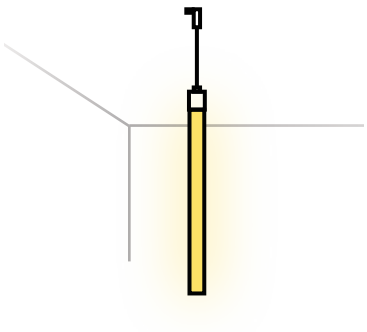

VN-25-SP-V-2M*

*Polycarbonate sleeve (not pictured) is required for Vine to hang perfectly vertical. See suspended pendant installation instructions for more info.

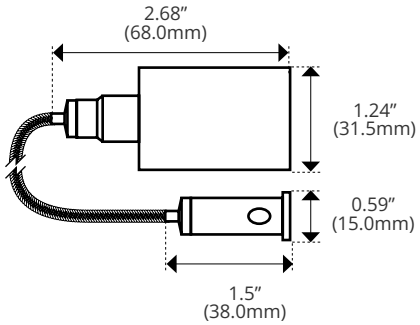

Kelvix reserves the right to update the product specifications at any time. To maintain warranty, field modifications must follow approved Kelvix installation instruction.
Conforms to ANSI/UL Standard 2108
Certified to CAN/CSA Standard C22.2 No. 250.2

Fixture Type _____

Project Name _____

Location _____